



Construction Safety

SSC Construction Inspection Safety Findings/Stats

February 2020



Contact Info:



NASA Safety

Matthew Scott

matthew.r.scott@nasa.gov

228-688-1537

Construction Safety

Donna Dubuisson

donna.a.dubuisson@nasa.gov

228-688-1167

Construction Safety

Elizabeth Calantoni
elizabeth.calantoni@nasa.gov
228-688-1804
B2 Test Stand

Neil Toupin
neil.s.toupin@nasa.gov
228-688-1109
A1 Test Stand

http://constructionsafety.ssc.nasa.gov/



Contact Info:



BASTION/SACOM Safety

Donald Smith, CHST donald.g.smith-1@nasa.gov 228-688-1085 phone 228-234-0639 Cell

John Lindsay, CSP john.d.lindsay@nasa.gov 228-688-2557 phone 288-688-3503 fax Mark Bridenbeck, TES

mark.a.bridenbeck@nasa.gov

228-688-1732 phone

228-313-0188 Cell

Will Davis
william.b.davis@nasa.gov
228-688-3193 phone
228-688-3503 fax

http://constructionsafety.ssc.nasa.gov/



With Sa



Construction Safety Report: 01 February – 07 February 2020

Findings: 0

Level 1 Severity: 0

(Corrected on the spot)

Level 2 Severity: 0

(Corrective action documented)

Mishaps: 0 / Close Calls: 0



MS SOLON

Construction Safety Report: 10 February – 14 February 2020

Findings: 0

Level 1 Severity: 0

(Corrected on the spot)

Level 2 Severity: 0

(Corrective action documented)

Mishaps: 0 / Close Calls: 0



Construction Safety Report: 17 February – 21 February 2020



Findings: 0

Level 1 Severity: 0

(Corrected on the spot)

Level 2 Severity: 0

(Corrective action documented)

Mishaps: 0 / Close Calls: 0



Construction Safety Report: 24 February – 29 February 2020



Findings: 0

Level 1 Severity: 0

(Corrected on the spot)

Level 2 Severity: 0

(Corrective action documented)


Mishaps: 0 / Close Calls: 1

<u>E-Complex Deluge Electrical System</u>: On February 28,2020 a contractor track hoe ran over a buried 1 inch water line on the South side field area of Building 4010. The buried water line was once used to feed temporary trailers which was capped and left pressurized. S-3 shops were called out to find and close the water supply valve. There were no interruptions of water to any facility. A Close Call SSC form 1627 was completed and submitted.





Construction Safety Findings:

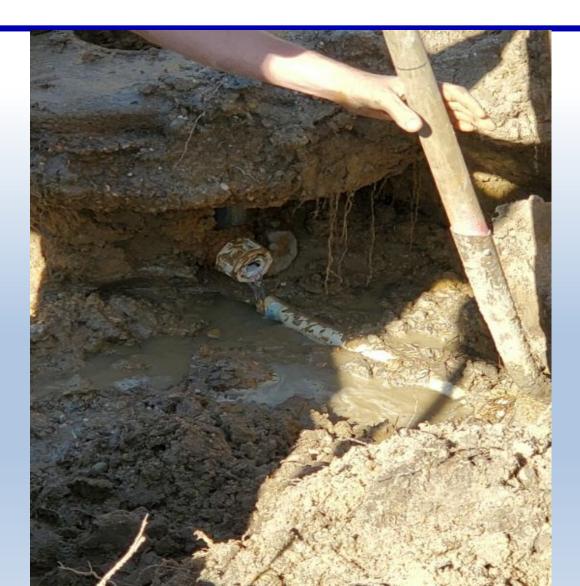





Notification Reminder:

For all Incidents, accidents and close calls

688-3636 for notification and emergency response if necessary

Notify your COR and CM



Questions/Discussion





http://constructionsafety.ssc.nasa.gov/